
# Monitoring Relays 1-Phase True RMS AC/DC Over or Under Current Type DIB71

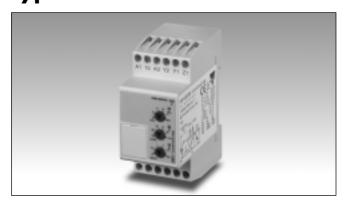

- TRMS AC/DC over or under current monitoring relay
- Current measuring through internal shunt
- Selection of measuring range by DIP-switches
- Measuring ranges from 0.1 mA to 5 A AC/DC
- Adjustable current on relative scale
- · Adjustable hysteresis on relative scale
- Adjustable delay function (0.1 to 30 s)
- Programmable latching or inhibit at set level
- Output: 5 A SPDT relay N.D. or N.E. selectable
- For mounting on DIN-rail in accordance with DIN/EN 50 022
- 35.5 mm DIN-rail housing
- . LED indication for relay, alarm and power supply ON
- Galvanically separated power supply

### **Product Description**

DIB71 is a precise TRMS AC/DC over or under current (selectable by DIP-switch) monitoring relays. Direct measuring or through current transformer.

Owing to the built-in latch function, the ON-position of the relay output can be maintained. Inhibit function can be used to avoid relay operation when not desired (maintenance, transitions). The LED's indicate the state of the alarm and the output relay. Through the built-in shunt it is possible to monitor loads up to 5 A AC/DC. 35.5 mm wide housing suitable both for back and front panel mounting.

Ordering Key	DIB 71 C B23 54
Housing —	
Function —	
Type ————	
Item number —	
Output —	
Power supply ————	
Measuring range ———	

## **Type Selection**

Mounting	Output	Measuring range	Supply: 24/48 VAC	Supply: 115/230 VAC
DIN-rail	SPDT	0.1 to 5 mA AC/DC	DIB 71 C B48 5mA	DIB 71 C B23 5mA
DIN-rail	SPDT	1 to 50 mA AC/DC	DIB 71 C B48 50mA	DIB 71 C B23 50mA
DIN-rail	SPDT	10 to 500 mA AC/DC	DIB 71 C B48 500mA	DIB 71 C B23 500mA
DIN-rail	SPDT	0.1 to 5 A AC/DC	DIB 71 C B48 5A	DIB 71 C B23 5A

## **Input Specifications**

Input	T		Measuring	ranges (cont.)		
Current level	Terminals Y1, Y2		5A: (	0.1 to 1 A AC/DC	Internal resist. $0.03~\Omega$	<b>Max. curr.</b> 6 A
Measuring ranges 5MA: 0.1 to 1 mA AC/DC 0.2 to 2 mA AC/DC	Internal resist. Max. curr. $0.5 \text{ to } 5 \text{ A AC}$ . Max. curr. $100 \Omega$ $40 \text{ mA}$ Max. current for	0.2 to 2 A AC/DC 0.5 to 5 A AC/DC ax. current for 1 s	0.03 Ω 0.03 Ω	6 A 6 A 15 A		
0.5 to 5 mA AC/DC Max. current for 1 s	100 Ω	40 mA 100 mA	TADK2	CT (examples) 50 A/5 A	AAC <sub>rms</sub> 5 to 50 A	Max. curr. 60 A
50MA: 1 to 10 mA AC/DC 2 to 20 mA AC/DC 5 to 50 mA AC/DC Max. current for 1 s	10 Ω 10 Ω 10 Ω	120 mA 120 mA 120 mA 300 mA	TAD2 TAD6 TAD12 TACO20	150 A/5 A 400 A/5 A 1000 A/5 A 6000 A/5 A	15 to 150 A 40 to 400 A 100 to 1000 A 600 to 6000 A	180 A 480 A 1200 A 7200 A
500MA:10 to 100 mA AC/DC 20 to 200 mA AC/DC 50 to 500 mA AC/DC Max. current for 1 s	1 Ω 1 Ω 1 Ω	700 mA 700 mA 700 mA 1.4 A	Contact in Disabled Enabled Latch disa		Terminals Z1, Y $>$ 10 k $\Omega$ $<$ 500 $\Omega$ $>$ 500 ms	1



## **Output Specifications**

Output Rated insulation voltage	SPDT relay 250 VAC	
Contact ratings (AgSnO <sub>2</sub> ) Resistive loads AC 1 DC 12	μ 5 A @ 250 VAC 5 A @ 24 VDC	
Small inductive loads AC 15 DC 13	2.5 A @ 250 VAC 2.5 A @ 24 VDC	
Mechanical life	≥ 30 x 10 <sup>6</sup> operations	
Electrical life	$\geq$ 10 <sup>5</sup> operations (at 5 A, 250 V, cos $\varphi$ = 1)	
Operating frequency	≤ 7200 operations/h	
Dielectric strength		
Dielectric voltage	2 kVAC (rms)	
Rated impulse withstand volt.	4 kV (1.2/50 μs)	

## **Supply Specifications**

Power supply Rated operational voltage through terminals: A1, A2 or A3, A2	Overvoltage cat. III (IEC 60664, IEC 60038)
B48:	24/48 VAC ± 15%
B23:	45 to 65 Hz, insulated 115/230 VAC ± 15% 45 to 65 Hz, insulated
Dielectric voltage	
Supply to input	4 kV (1.2/50 μs)
Supply to output	4 kV (1.2/50 μs)
Input to output	4 kV (1.2/50 μs)
Rated operational power	
AC	3 VA

## **General Specifications**

Power ON delay	1 s ± 0.5 s or 6 s ± 0.5 s
Reaction time	(input signal variation from -20% to +20% or from +20% to -20% of set value)
Alarm ON delay Alarm OFF delay	< 100 ms < 100 ms
Accuracy Temperature drift	(15 min warm-up time) ± 1000 ppm/°C
Delay ON alarm Repeatability	± 10% on set value ± 50 ms ± 0.5% on full-scale
Indication for	
Power supply ON Alarm ON	LED, green LED, red (flashing 2 Hz during delay time)
Output relay ON	LED, yellow
Environment  Degree of protection  Pollution degree  Operating temperature	(EN 60529) IP 20 3
5A others Storage temperature	-20 to 50°C, R.H. < 95% -20 to 60°C, R.H. < 95% -30 to 80°C, R.H. < 95%
Housing dimensions	35.5 x 81 x 67.2 mm
Weight	Approx. 150 g
Screw terminals	
Tightening torque	Max. 0.5 Nm acc. to IEC 60947
Approvals	UL, CSA
CE Marking	Yes
EMC Immunity Emission	Electromagnetic Compatibility According to EN 61000-6-2 According to EN 61000-6-3

## **Mode of Operation**

DIB71 monitors both AC and DC over or under current through an internal shunt.

#### Example 1

(connection between terminals Z1, Y1 - latching function enabled)

The relay operates and latches in operating position when the measured value exceeds (or drops below) the set level for more than the

set delay time. Provided that the current has dropped below (or has exceeded) the set point (see hysteresis setting), the relay releases when the interconnection between terminals Z1, Y1 is interrupted or the power supply is interrupted as well.

The red LED flashes until the delay time has expired or the measured value comes back to a non-alarm value (see hysteresis setting).

#### Example 2 (Stardard CT)

(no connection between terminals Z1, Y1 - latch function disabled)

The relay operates when the measured value exceeds (or drops below) the set level for more than the set delay time. It releases when the current drops below (or exceeds) the set level (see hysteresis setting) or when power supply is interrupted.

#### Note

When the inhibit contact is opened, if the input signal is already in alarm position, the delay time needs to elapse before relay activation.

## Function/Range/Level and Time Delay Setting

Adjust the input range setting the DIP switches 1 and 2 as shown in figure.

Select the desired function setting the DIP switches 3 to 6 as shown in figure.

To access the DIP switches open the plastic cover as shown in figure.

Selection of level and time delay:

#### Upper knob:


Setting of hysteresis on relative scale: 0 to 30% on set value.

#### Centre knob:


Current level setting on relative scale: 10 to 110% on full scale.

#### Lower knob:

Setting of delay on alarm time on absolute scale (0.1 to 30 s).

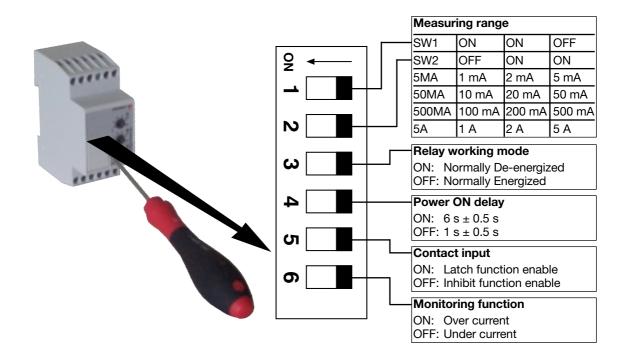


## **Wiring Diagrams**

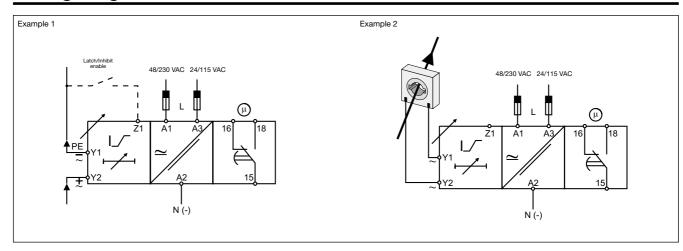


# **Operation Diagrams**


#### Over current - N.D. relay




#### Under current - Latch function - N.D. relay

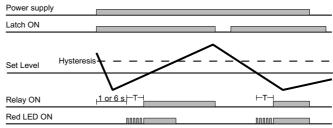

#### Under current - N.D. relay



#### Over current - Inhibit function - N.D. relay

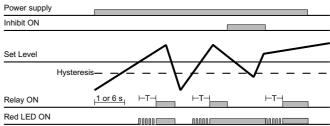

## **Dimensions**

