



# Pivot Seal Pressure Switches for Fluid Power Applications

Form 219

**SOR's Pivot Seal pressure switches** are rugged, field-mounted instruments that incorporate a flexible modular design providing cost effective sensing solutions.

The pressure sensing element of the Pivot Seal pressure switch is a force-balance, piston-actuated assembly sealed by an o-ring. As with all SOR pressure switches, the actual motion of the piston to actuate the micro switch is only several thousandths of an inch, resulting in minimal o-ring wear. Media pressure on the area of the piston counteracts the force of the range spring (adjustable by the adjusting nut screw) and moves the piston shaft and the force transmitter to directly actuate the electrical snap-action switching element.

## Application Information

The design of the piston/port assembly results in the device being well-suited for a wide variety of high pressure fluid power (hydraulic) applications, especially where high-shock pressures and high-cycle rates are expected, and where normal industrial clean hydraulic fluid is used.



### Features and Benefits

#### Modular Design

- Wide range of electrical enclosures available.

#### Construction

- Rugged, high cycle rate tolerance.
- Long life.
- Not critical to vibration, high overrange and proof pressures.
- Excellent corrosion resistance to hostile environments.

#### Instrument Quality

- High repeatability.
- Narrow dead band.
- Negligible temperature effect.

#### Delivery

- Routine shipments 7 to 10 working days.
- Emergency shipments via air same day.

#### Service

- Factory service engineers and area factory representatives provide effective and prompt worldwide service.

#### Wetted Parts

- Wide selection of materials.

#### Field Adjustability

- Excellent resolution of Set Points, adjustment, no special tools required.
- No-charge factory calibration.

#### Warranty

- 3 years from date of manufacture.

### Model Number System

# 2NN-K3-P1-D1A-PP



### Quick Selection Guide

Basic Pivot Seal pressure switches with standard wetted parts are normally suitable for a wide variety of high-pressure fluid power (hydraulic) applications, especially where high-shock pressures and high-cycle rates are expected, and where normal industrially clean hydraulic fluid is used. Refer to the Quick Selection Guide section on page 3. Corrosive service and particular customer requirements may require optional components. Refer to the How to Order section on this page or the dedicated page to locate optional components, such as: housings, switching elements, o-ring seals, pressure ports and accessories. Each position in the model number, except Accessories, must have a designator.

### Applications

The Pivot Seal pressure switches in this catalog are suitable for a wide variety of fluid power applications. Specific application requirements can normally be met by selecting optional components, such as, switching elements and o-ring seal. Certain applications may require customized specials. Consult area factory representative or the factory.

**Note:** The SOR Pivot Seal is not suitable for process applications. Refer to Form 216 – Pressure Vacuum Switches for Pressure Applications.

Weathertight, Conventional Explosion Proof and Hermetically Sealed Explosion Proof models are presented in this catalog.

### How to Order

Steps 1 through 5 are required; step 6 is optional. Orders must have complete model numbers, i.e. each component must have a designator.

**Step 1:** Select **Adjustable Range** according to set point (page 4).

**Step 2:** Select **Housing** for type of service (page 5).

**Step 3:** Select electrical **Switching Element** for housing and electrical service (page 6).

**Step 4:** Select **O-Ring Seal** for process compatibility and containment (page 7).

**Step 5:** Select **Pressure Port** for process connection (page 7).

**Step 6:** Select **Accessories** as required for service (page 8).

If Agency Listed, Certified or Approved pressure switches are required, see page 9 & 10 for components that must be specified.

# Pivot Seal Pressure Switches

## Quick Selection Guide

Specify model number from table below.



Model Number	Range	Typical Dead Band (psi)	Electrical Rating	Electrical Connection	Housing Material
2NN - K3 - P1 - D1A	100 to 1900	80	15 amps 250 VAC	3/4" NPT(F)	Aluminum
2NN - K5 - P1 - D1A	500 to 3000	100			
3NN - K45 - P1 - D1A	1000 to 7000	180			

Weathertight NEMA 4, 4X, IP65



Model Number	Range	Typical Dead Band (psi)	Electrical Rating	Electrical Connection	Housing Material
2L - K3 - P1 - D1A	100 to 1900	80	15 amps 250 VAC	3/4" NPT(F)	Cast Iron
2L - K5 - P1 - D1A	500 to 3000	100			
3L - K45 - P1 - D1A	1000 to 7000	180			

Hazardous Locations – Class I, Groups C & D; Class II, Groups E, F, G; Divisions 1 & 2  
(as an outlet box)



Model Number	Range	Typical Dead Band (psi)	Electrical Rating	Electrical Connection	Housing Material
2AG - EF3 - P1 - D1A	100 to 1900	80	5 amps 250 VAC	1/2" NPT(M)	Aluminum
2AG - EF5 - P1 - D1A	500 to 3000	100			
3AG - EF45 - P1 - D1A	1000 to 7000	180			

Hazardous Locations – Class I, Groups A, B, C, & D; Class II, Groups E, F, G; Divisions 1 & 2

### Standard Construction

Pressure Port	1/4" NPT(F)	Wetted Materials	
Overrange	8,000 psi	Piston	300 Series stainless steel
Proof Pressure	10,000 psi	O-Ring	Buna-N
		Pressure Connection	Brass

# Pivot Seal Pressure Switches

## Step 1: Adjustable Range

2NN-K3-P1-D1A-PP

Piston-Spring Designators	Adjustable Range		Typical Dead Band		Overrange Pressure		Proof Pressure	
	psi	bar	psi	bar	psi	bar	psi	bar
2 - 3	100 to 1900	7 to 130	80	5	8000	550	10,000	700
2 - 5	500 to 3000	35 to 210	100	7				
3 - 45	1000 to 7000	70 to 480	180	12				

### Notes

1. Ambient temperature range: -30° to 180°F (-34 to 80°C). Check restrictions, page 6, for optional electrical switching elements and page 7 for optional o-ring seals.
2. Bar values may not be exact mathematical conversions. They are practical equivalents.

### Dead Band Considerations

1. Dead band values are expressed as typical expected at mid-adjustable range using the standard K switching element.
2. A dead band multiplier must be applied to the typical dead band value shown in adjustable range above whenever an optional switching element is specified.
3. Dead band can be widened by selecting an optional switching element with a multiplier greater than 1.0.

Example: Model 2NN-L3-P1-D1A-PP  
 Typical Dead Band: 80 psi  
 L Switching Element Multiplier 1.5  
 Corrected Typical Dead Band  $80 \times 1.5 = 120$  psi




Switching Element Designators	Dead Band Multiplier
A, B, BD, D, E, EF, G, GA, J, JF, JR, K, KA, KB, M, W, Y	1.0
AF, C, EB, EE, EG, GG, JB, JG, JJ, KK, L, S, YY	1.5
AA, AG, BB, LL	2.0

# Pivot Seal Pressure Switches







## Step 2: Housings

2NN-K3-P1-D1A-PP







### General Purpose – NEMA 1

 <p>Electrical: 3/4" NPT(F)-Right Material: Aluminum <b>PP</b></p> <p>See Agency Listings page 10. See Switching Element Groups 1, 2, 3, 4 page 6.</p>	 <p>Electrical: 3/4" NPT(F)-Left, Right Material: Aluminum <b>P3</b></p> <p>See Switching Element Groups 1, 2, 3, 4 page 6.</p>	 <p>Electrical: Exposed Contacts Material: Aluminum Open bracket with exposed switching element does not meet NEMA 1. <b>H3</b></p> <p>See Switching Element Groups 1, 3 page 6.</p>
---	--	---








### Weathertight –NEMA 4, 4X, IP65

 <p>Electrical: 3/4" NPT(F)-Right Material: Aluminum <b>NN</b></p> <p>See Agency Listings page 10. See Switching Element Groups 1, 2, 3, 4 page 6.</p>	 <p>Electrical: 3/4" NPT(F)-Left, Right Material: Aluminum <b>N3</b></p> <p>See Agency Listings page 10 See Switching Element Groups 1, 2, 3, 4 page 6.</p>	 <p>Electrical: 3/4" NPT(F) - Right Material: Aluminum Cover: Heavy duty with Viton gasket <b>N4</b></p> <p>Switching Element Groups 1, 2, 3, 4 page 6.</p>
 <p>Electrical: 3/4" NPT(F)-Right Material: Carbon Steel <b>N6</b></p> <p>See Switching Element Groups 1, 3 page 6.</p>	 <p>Electrical - RN: 3/4" NPT(F)-Right Electrical - RM: M20 x 1.5 - Right Standard terminal block Material: Aluminum <b>RN</b> <b>RM</b></p> <p>See Agency Listings page 10. Switching Element Groups 1, 2, 3, 4, 5 page 6.</p>	 <p>Electrical-RT: 3/4" NPT(F)-Right Electrical-RS: M20 x 1.5-Right Standard terminal block Material: 316SS <b>RT</b> <b>RS</b></p> <p>See Agency Listings page 10. Switching Element Groups 1, 2, 3, 4, 5 page 6.</p>
<p>See Form 987 for Omni Weathertight Pivot Seal Pressure Switches.</p>		

### Hazardous Locations –Hermetically Sealed

 <p>Contains UL Listed and CSA Certified hermetically sealed switching element. Electrical: 1/2" NPT(M)-Top Material: Copper-free** aluminum <b>AG</b></p> <p>See Switching Element Group 5 page 6.</p>	 <p>CENELEC/BASEEFA Certified (EE xd IIC T6) Electrical: 1/2" NPT(M)-Top Material: Copper-free* aluminum <b>BG</b></p> <p>See Agency Listings page 10. Switching Element Group 5, page 6.</p>	 <p>Mini Hermet Type JIS/RIIS Approved (IIC T6) 316SS housing 1/2" NPT(M) electrical connection <b>JH</b></p> <p>See Agency Listings page 10. See Switching Element Group 5 page 6.</p>
 <p>Contains UL Listed and CSA Certified hermetically sealed switching element. Electrical: 1/2" NPT(M)-Top Material: 316SS <b>AH</b></p> <p>See Switching Element Group 5 page 6.</p>	 <p>CENELEC/BASEEFA Certified (EExd IIC T6) Electrical: 1/2" NPT(M)-Top Material: 316SS <b>BH</b></p> <p>See Agency Listings page 10 Switching Element Group 5 page 6.</p>	 <p>Contains UL Listed and CSA Certified hermetically sealed switching elements. Electrical: 3/4" NPT(F) - Top Material: Copper-free** aluminum Weathertight: NEMA 4/4X <b>*BA</b></p> <p>See Switching Element Group 6 page 6.</p>

### Hazardous Locations – Conventional Explosion Proof

 <p>UL Listed Class I, Group C &amp; D; Class II, Group E, F, G; Division 1 &amp; 2 as an outlet box only. Electrical: 3/4" NPT(F)-Right Material: Cast Iron Weathertight with Option CG <b>*L</b></p> <p>See Switching Element Groups 1, 3 page 6.</p>	 <p>UL Listed Class I, Group C, D; Class II, Group E, F, G; Division 1 &amp; 2 as an outlet box only. Electrical: 3/4" NPT(F)-Right Material: Copper-free** aluminum Weathertight <b>*LC</b></p> <p>See Switching Element Groups 1, 2, 3, 4 page 6.</p>	 <p>Separate electrical and set point adjustment compartments Weathertight Standard terminal block UL Listed with WV option - page 10. CENELEC/BASEEFA with CL option page 10. CSA Certified with CS option - page 10.</p> <p><b>*B3</b> Electrical: 3/4" NPT(F)-Left, Right Material: Aluminum</p> <p><b>*B4</b> Electrical: M20 x 1.5-Left, Right Material: Aluminum</p> <p><b>*B5</b> Electrical: M20 x 1.5-Left, Right Material: Cast Iron</p> <p><b>*B6</b> Electrical: 3/4" NPT(F)-Left, Right Material: Cast Iron</p> <p>Switching Element Groups 1, 2, 3, 4, 5 page 6.</p>
 <p>UL Listed Class I, Group C &amp; D; Class II, Group E, F, G; Division 1 &amp; 2 as an outlet box only. Electrical: 3/4" NPT(F)-Left, Right, Top Material: Cast Iron Weathertight with Option CG <b>*S</b></p> <p>See Switching Element Groups 1, 3, 7 page 6.</p>	 <p>UL Listed Class I, Group C, D; Class II, Group E, F, G; Division 1 &amp; 2 as an outlet box only. Electrical: 3/4" NPT(F)-Left, Right, Top Material: Copper-free** aluminum Weathertight <b>*SC</b></p> <p>Switching Element Groups 1, 2, 3, 4, 7 page 6.</p>	
 <p>Class I, Group A, B, C &amp; D; Class II, Group E, F, G; Division 1 &amp; 2 as an outlet box only. Electrical: 3/4" NPT(F)-Left, Right, Top Material: (Housing): Cast Iron Material: (Cover): Aluminum Weathertight with Option CG <b>*TA</b></p> <p>See Switching Element Groups 1, 3 page 6.</p>	 <p>Explosion Proof IIB-T4. Separate electrical and set point adjustment compartments. Aluminum. Six-place screw-type terminal block is standard. Right hand electrical outlet: PF 3/4" (F) <b>*J4</b></p> <p>See Switching Element Groups 1, 2, 3, 4 page 6.</p>	

\* Not recommended for direct mount where vibration is expected. Housing should be securely mounted to a flat surface (bulkhead or panel rack) or pipe stanchion. \*\* Consult factory.

# Pivot Seal Pressure Switches

## Step 3: Switching Element

2NN-K3-P1-D1A-PP

### Switching Element Group/Housing Compatibility

Group 1	Group 2	Group 3	Group 4	Group 5	Group 6	Group 7
A, AA, B, BB, BD*, C**, E, EE, G, J, JJ, K, KA, L, S, W, Y	GG, KK, LL, YY	T	H	AF, AG, EF, EG, JF, JG	EB, JB, JR, KB	D, M

\*BD only available with RN, RT housings

\*\*C micro switch is not available in L, S, and TA housings

Cross reference compatibility chart above to ensure that switching element will fit in housing.

Switching Element Service	Electrical Contact Type	Electrical Connection Type	AC Rating		DC Rating Resistive				Dead Band Multiplier		Designator	
			Volts	Amps	Volts	Amps	Volts	Amps	SPDT	DPDT	SPDT	DPDT
Normal Service AC	Single Switching Element SPDT – (1) SPDT Double Switching Element DPDT – (2) SPDT Synchronized actuation/deactuation at increasing/decreasing Set Points.	K, KA, G, L, C, N, S, Y, W Switching Elements – Screw Terminals All other switching elements – 18” 18 AWG Color coded wire leads except when terminal blocks are specified.	250	15	125	.4*	30	5*	1	1.5	K	KK
Low Power Gold Contacts			125	1	-	-	28	1*	1	-	KA	N/A
Wide Dead Band AC			125	1	-	-	30	1	1	1.5	J	JJ
AC or DC			250	15	125	.5	-	-	1	1.5	G	GG
Wide Dead Band DC			250	11	125	.5*	30	5.0	1	2	A	AA
Narrow Dead Band DC			250	15	-	-	30	10*	1.5	2	L	LL
Very Wide Dead Band DC			250	5	125	.5*	30	5.0*	1	1.5	E	EE
Very High Capacity DC Magnetic Blow-Out			250	15	125	.5	-	-	1.5	-	C	N/A
Hi Ambient Temperature Rating - 400°F			125	10	125	1.5 Minimum 10.0 Maximum	-	-	1.5	-	S	N/A
Manual Reset - Decreasing Pressure (Automatic Actuation Increasing Pressure)			250	5	125	.3	-	-	1	2	B	BB
Manual Reset - Increasing Pressure (Automatic Actuation Decreasing Pressure)			250	5	125	5*	-	-	1	1.5	Y	YY
Corrosion Resistant Explosion Proof Hermetically Sealed Switching Element			250	5	125	.3*	-	-	1	-	W	N/A
Corrosion Resistant Explosion Proof Lower Power Service Hermetically Sealed Gold Contacts			250	15	125	0.5	-	-	1	-	D	N/A
Explosion Proof EEx d IIC T6			250	15	125	0.4*	30	5*	1	-	KB	N/A
			250	5	125	0.5*	30	5*	-	1.5	N/A	EB
			250	11	125	0.5*	30	5	1.5	2	AF	AG
			250	5	125	0.5*	30	5*	1	1.5	EF	EG
			125	1	-	-	28	1*	1	-	JR	N/A
			125	1	-	-	30	1	-	1.5	N/A	JB
	125	1	-	-	30	1	1	1.5	JF	JG		
	250	7	250	0.25	30	7	1	-	BD	N/A		

# Pivot Seal Pressure Switches

## Step 3: Switching Element

2NN-K3-P1-D1A-PP

### Notes

- Double switching elements have wire leads except when supplied in housings RN, RT RB, B3, B4, B5, B6 and J4. Terminal blocks are standard in these housings.
- Dead band multipliers must be applied to the typical dead band figures given in the specification tables on page 5.
- Switching element ambient temperature limits:
  - 65 to 400°F (-54 to 200°C) B, Y, W
  - 65 to 250°F (-54 to 120°C) A, E & J
  - 40 to 167°F (-40 to 75°C) AF, AG, EB, EF, EG, JB, JF, JG, JR, KB
  - 13 to 158°F (-25 to 70°C) BD
  - 65 to 180°F (-54 to 80°C) All others
- The hermetically sealed switching element capsule is UL Listed, CSA Certified and SAA Approved as an explosion proof snap switch according to the following table with conditions and exceptions specified in Note 3.

Agency	Hazardous Location Conditions	Designator
UL Listed CSA Certified	Class I, Groups A, B, C & D Class II, Groups E, F & G; Division 1 & 2	AF, EF, AG, EG, KB, EB, JB, JF, JG, JR
SAA Approved	Ex s IIC T6 IP65 Class 1, Zone 1 DIP T6 IP65	AF, EF, AG, EG, KB, EB

- Switching Elements W & Y have Elgiloy springs.
- Certain switching elements can handle greater voltage and/or amperage. Consult the factory should your requirements exceed catalog values. All switching elements above except BD are UL Recognized and CSA Certified. The DC current ratings marked with an asterisk (\*) are not UL Listed but have been verified by testing and/or experience.
- Use of BD switching elements may allow certain weathertight housings to be used in flammable or hazardous atmospheres. Contact the factory for details. See NEMKO/CENELEC block under Agency Listings on page 10.

**CAUTION:** The switching element assembly has been precisely positioned in the housing at the factory for optimum performance. Any inadvertant movement or replacement in the field will degrade performance, could render the device inoperative, and can void the warranty unless factory authorized procedures are followed.

## Step 4: O-Ring Seal

2NN-K3-P1-D1A-PP

O-Ring (Wetted)	Designator
Buna N (Standard)	P1
EPR	Y1
Viton	S1

given process. Empirical experience by users should be the final guide. Alternate materials based on this are generally available.

- This table shows allowable minimum and maximum temperatures for o-rings.

O-Ring Material	°F	°C
Viton	32 to 250	0 to 120
Buna-N EPR	32 to 200	0 to 93

### Notes

- Wetted parts have been selected as representing the most suitable commercially available material for use in the service intended. However, they do not constitute a guarantee against corrosion or permeation, since processes vary from plant to plant and concentration of harmful fluids, gases or solids vary from time to time in a

## Step 5: Pressure Port

2NN-K3-P1-D1A-PP

Material	Connection Size	Designator
Brass	1/4" NPT(F)	D1A
316SS		C1A
Brass	9/16-18" (F) SAE Straight Thread O-Ring Seal	D4C
316SS		C4C

### Note

C1A pressure port is standard on AH and BH housings. D1A is standard on all other housings.

# Pivot Seal Pressure Switches

## Step 6: Accessories

2NN-K3-P1-D1A-PP

Accessory / Option & Description		Designator
Neoprene cover gasket (o-ring) to make L, S and TA explosion proof housings weathertight.		CG
CENELEC (BASEEFA) Certified pressure switch. Available with B3, B4, B5, and B6 housings. See Agency Listings on page 10.		CL
CSA Certified pressure switch. Available with PP, NN, RB, RN, RT, B3 and B6. Housing has earth (ground) lug.		CS
Cemented cover gasket on weathertight housings.		GC
Sealed electrical lead adapter. Provides protection to housing interior, switching element dry side of pressure sensing assembly from condensate in electrical conduit and corrosive atmospheres. CSA Certified Classes I, II, III, Groups A, B, C, D, E, F, G; Type 4, 4X. (Protrudes approximately 2" from housing.)		GG
Universal terminal box. Stainless steel. 1/2" NPT(F). CENELEC Certified EEx d IIC T4, T5, T6.		HB
Universal terminal box. Stainless steel. M20 x 1.5(F). CENELEC Certified EEx d IIC T4, T5, T6.		HBME
Universal terminal box. Stainless steel. 1/2" NPT(F). FM Approved and CSA Certified. Explosion proof Class I, Groups A, B, C, D; Class II, Groups E, F, G, Class III Division 1 (NEMA 4X, IP65)		HT
Breather Drain	Crouse Hinds ECD-15 for Hazardous Locations Class I, Groups C & D; Class II, Groups E, F and G; on S or SC housings only.	KK
	Sintered metal plug in weathertight housing.	
Terminal block. 6-place compression type standard in B and R series housings. Optional in LC and SC housings. 6-place screw-type standard in J4 housing.		LL
Carbon steel body with stainless steel adjusting nut.		PB
Pipe (stanchion) mounting kit for (1-1/2 to 2" pipe). Order as a separate line item for UL Listed and CSA Certified pressure switches.		PK
Tag, fiber. Attached with plastic wire to housing. Stamped with customer specified tagging information.		PP
Tag, stainless steel. Attached with stainless steel wire to housing. Stamped with customer specified tagging information. (2 lines, 18 characters and spaces per line.)		RR
Stainless steel body, force transmitter and adjusting nut for corrosive environments. Standard on stainless steel housings		SB
Explosion proof and weathertight electrical junction box with screw terminals. 3/4" NPT(F) top or right conduit connections as required. UL Listed and CSA Certified Class I, Groups A, B, C & D; Class II, Groups E, F & G; Division 1 & 2. (L, LC, S, SC and TA housing.) Includes cover o-ring for weathertight applications.		TB
Oversize stainless steel nameplate or separate stainless steel tag. Permanently attached to housing. Stamped with customer specified tagging information.		TT
Fungicidal varnish. Covers exterior and interior except working parts.		VV
Epoxy coating. Exterior only. Polyamide epoxy with 316SS pigment.		YY
Chained cover with captive screws to conform to former JIC specification		ZZ
"X" is used as a suffix to the Model Number for special requirements not keyed elsewhere in the model number by an "X". Each "X" must be completely identified in the text of the order or inquiry. When more than one "X" is required, use "X" followed by the number of such items. For example, "X3" means three separate otherwise unidentifiable requirements		X

**Representative Information Only:** A slash and a three-digit number (/000) appearing after the last Accessory designator letter in the model number denotes special administrative procedures with respect to factory representatives. It is not part of the model number and is used only by the factory or a factory representative.



# Pivot Seal Pressure Switches

## Agency Listings

### CSA

For Hazardous Locations Class I Groups B, C, D; Class II, Groups E, F, G; Division 1 & 2

Piston	Spring	Housing	Switching Element	Diaphragm & O-Ring	Pressure Port Material & Connection Size	Accessories
2, 3	All	B3	A, AA, B, BB, C, E, EE, G, GG, H, J, JJ, JL, K, KK, KA, L, LL, N, S, T, W, Y, YY Maximum: 15A @ 300 VAC 10A @ 125 VDC	All	All	CS Required All except KK, LL, ZZ, GC

General Purpose and Weathertight (CSA Enclosed 4)

Piston	Spring	Housing	Switching Element	Diaphragm & O-Ring	Pressure Port Material & Connection Size	Accessories
2, 3	All	PP (General Purpose)	A, AA, B, BB, C, E, EE, G, GG, GA, H, J, JJ, JL, K, KK, KA, L, LL, N, S, T, W, Y, YY	All	All	CS required
		NN (Enclosed 4)	A, AA, AF, AG, B, BB, C, E, EE, EF, EG, G, GG, GA, H, J, JJ, JL, JF, JG, K, KK, KA, L, LL, N, S, T, W, Y, YY			All except GC, LL
		RN (Enclosed 4) RT	D, DA, M (Manual Reset only)			
		RB (Enclosed 4)				

### JIS/RIIS

For Hazardous Locations Rating: Explosion Proof IIB T4

Piston	Spring	Housing	Switching Element	Diaphragm & O-Ring	Pressure Port Material & Connection Size	Accessories
2, 3	All	J4	A, AA, B, BB, C, E, EE, G, GG, H, J, JJ, K, KK, KA, L, LL, N, S, T, W, Y, YY	P1, S1, Y1	Material: C, D, M; Connection Size: 1, 2, 4 Thread Type: A, B, C	BB, NN, PB, PK, PP, RR, SB, TT, VV, YY, X

For Hazardous Locations Rating: Explosion Proof IIE T6

Piston	Spring	Housing	Switching Element	Diaphragm & O-Ring	Pressure Port Material & Connection Size	Accessories
2, 3	All	JH	AF, AG, EF, EG, JF, JG	P1, S1, Y1	Material: C, D, M; Connection Size: 1, 2, 4 Thread Type: A, B, C	BB, PK, PP, RR, TT, VV, YY

# Pivot Seal Pressure Switches

## Agency Listings

**CENELEC/ Electrical Equipment for Flammable Atmospheres**  
**BASEEFA Rating: EE x d IIC T6 per EN 50-014 & 018 BAS Certification Number EX 85B1304**

Piston	Spring	Housing	Switching Element	Diaphragm & O-Ring	Pressure Port Material & Connection Size	Accessories
2, 3	All	B3, B4, B5, B6	A, AA, AF, AG, B, BB, C, E, EE, EF, EG, G, GG, H, J, JF, JG, JJ, K, KA, KK, L, LL, N, S, T, W, Y, YY	All	All	CL Required All except CS, GC, GG, KK, LL, ZZ

**Electrical Equipment for Flammable Atmospheres**  
**Rating: EEx d IIC T6 per EN 50-014 & 018 BAS Certification Number 831281X**

Piston	Spring	Housing	Switching Element	Diaphragm & O-Ring	Pressure Port Material & Connection Size	Accessories
2	3, 5	BG, BH	AF, AG, EF, EG, JF, JG	P1, S1, Y1	Material: C, D, M Connection Size: 1, 2, 4 Thread Type: A, B, C	PP, RR, TT, VV, YY, PK
3	45					

**CENELEC/ Electrical Equipment for Flammable Atmospheres**  
**NEMKO Rating: EEx d/e IIC T6 NEMKO Certification Number 88.058**

Piston	Spring	Housing	Switching Element	Diaphragm & O-Ring	Pressure Port Material & Connection Size	Accessories
All	All	RS, RN, RT	BD	All	All	All

### Notes

1. Internal/external case ground (earth) screws provided.
2. Customer/user is responsible for electrical hook-up to terminal block and compliance with CENELEC and JIS/RIIS codes.

## Approximate Shipping Weights

Actual shipping weights may vary from charted values because of product material, configurations and packaging requirements.

Housing	Weight (lbs)	(kgs)	Housing	Weight (lbs)	(kgs)
AG, BG, H3	1.5	0.75	LC, SC	4	2
AH, BH, NN, N3, N4, PP, P3	2	1	BA, L, S	5	2.5
RB, RM, RN	2.5	1.25	TA	6	3
N6	3	1.5	B3, B4	8	4
RS, RT	3.5	1.75	B5, B6	10	5

### Notes

1. PK Pipe Kit adds approximately 1.5 lbs (0.7 kgs).
2. TB Junction Box adds approximately 4.5 lbs (2 kgs).

SOR recognizes that there is no industry convention with respect to terminology and definitions pertinent to pressure switches. This glossary applies to SOR Pressure Switches.

### Pressure Switch

A bi-stable electromechanical device that actuates/deactuates one or more electrical switching element(s) at a predetermined discrete pressure/vacuum (Set Point) upon rising or falling pressure/vacuum.

### Adjustable Range

The span of pressure between upper and lower limits within which the pressure switch can be adjusted to actuate/deactuate. It is expressed for increasing pressure.

### Set Point

That discrete pressure at which the pressure switch is adjusted to actuate/deactuate on rising or falling pressure. It must fall within the adjustable range and be called out as increasing or decreasing pressure.

### Dead Band

The difference in pressure between the increasing set point and the decreasing set point. It is expressed as typical, which is an average with the increasing set point at mid range for a pressure switch with the standard K switching element. It is normally fixed (non-adjustable).

### Hermetically Sealed

A welded steel capsule with glass-to-metal, factory-sealed, electrical leads that isolates the electrical switching element(s) from the environment.

### Overrange

The maximum input pressure that can be continuously applied to the pressure switch without causing permanent change of set point, leakage or material failure.

### Proof Pressure

The maximum input pressure that can be continuously applied to the pressure switch without causing leakage or catastrophic material failure. Permanent change of set points may occur, or the device may be rendered inoperative.

### Repeatability

The ability of a pressure switch to successively operate at a set point that is approached from a starting point in the same direction and returns to the starting point over three consecutive cycles to establish a pressure profile. The closeness of the measured set point values is normally expressed as a percentage of full scale (maximum adjustable range pressure).

### SPDT Switching Element

Single-Pole, Double Throw (SPDT) has three connections: C – Common, NO – Normally Open and NC – Normally Closed, which allows the switching element to be electrically connected to the circuit in either NO or NC state.

### DPDT Switching Element

DPDT is two synchronized SPDT switching elements which actuate together at increasing set point and deactuate together at decreasing set point. Discrete SPDT switching elements allow two independent circuits to be switched; i.e., one AC and one DC.


The synchronization linkage is factory set, and is not field adjustable. Synchronization is verified by connecting test lamps to the switching elements and observing them go “On” simultaneously at actuation and “Off” simultaneously at deactuation

# Pivot Seal Pressure Switches

## Dimensions


Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number. Dimensions in this catalog are expressed as millimeters over inches (Linear = mm/in.).

### Weathertight – Non-Hazardous Service (NEMA 4, 4X, IP65)

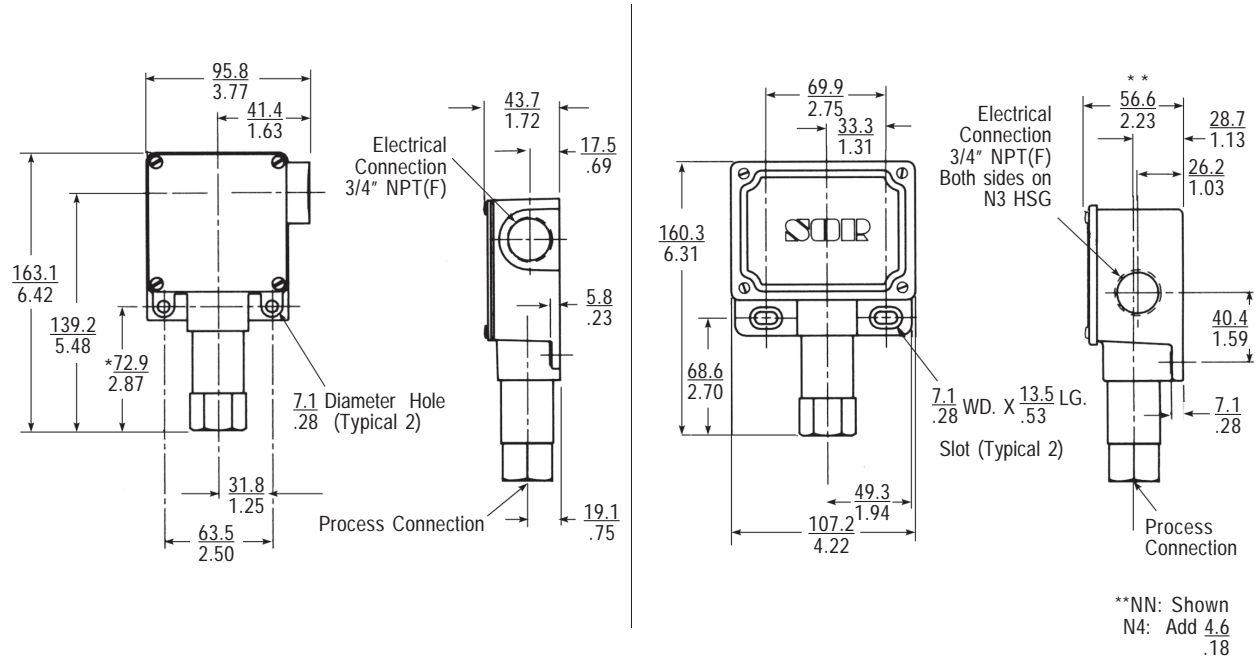

### Housing: N6

### Housing: NN, N3, N4

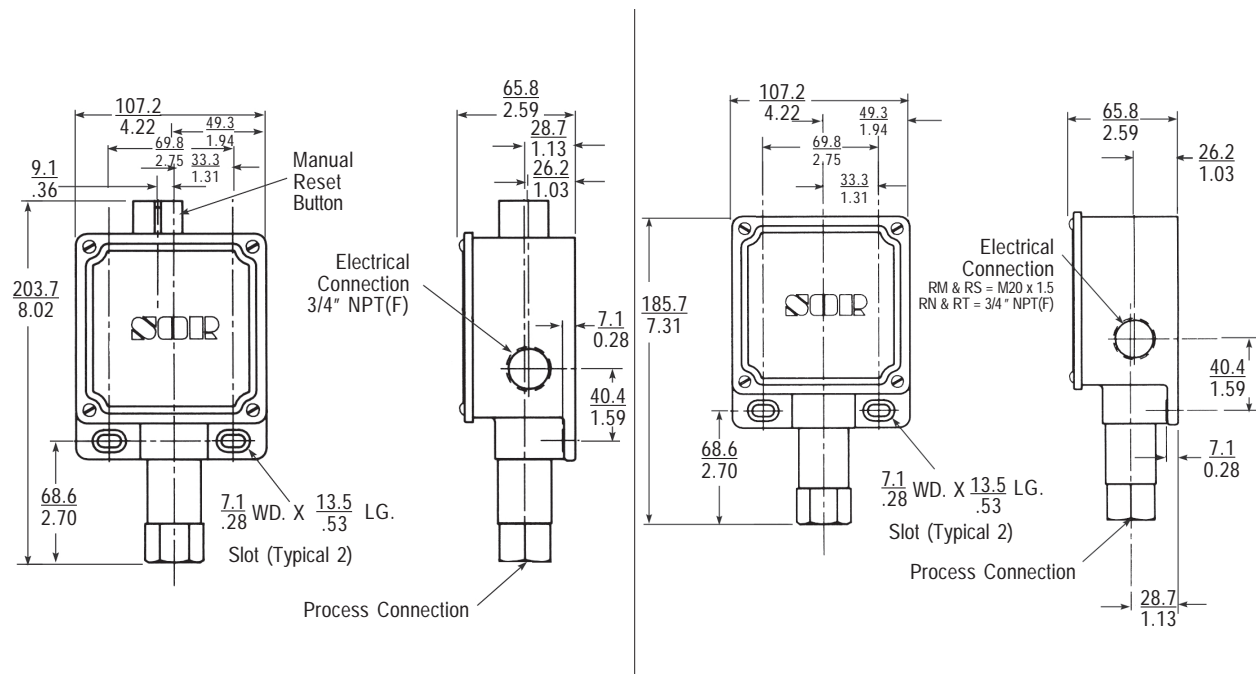

### Housing: RB Manual Reset


### Housing: RM, RN, RS, RT

# Pivot Seal Pressure Switches

## Dimensions


Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number. Dimensions in this catalog are expressed as millimeters over inches. (Linear = mm/in.).

### Conventional Explosion Proof – Hazardous Service

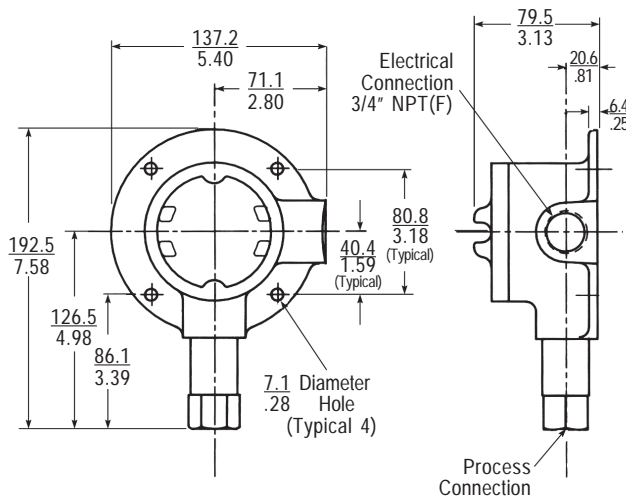


### Housing: L

Class I, Group C, D; Class II, Group E, F, G; Division 1 & 2

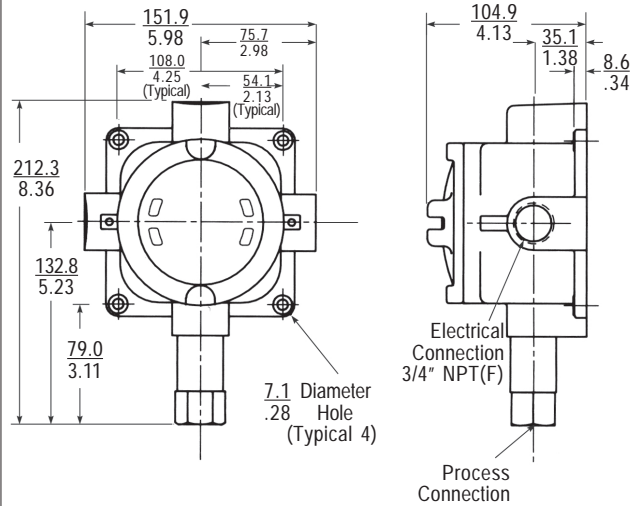


### Housing: LC

Class I, Group C, D; Class II, Group E, F, G; Division 1 & 2

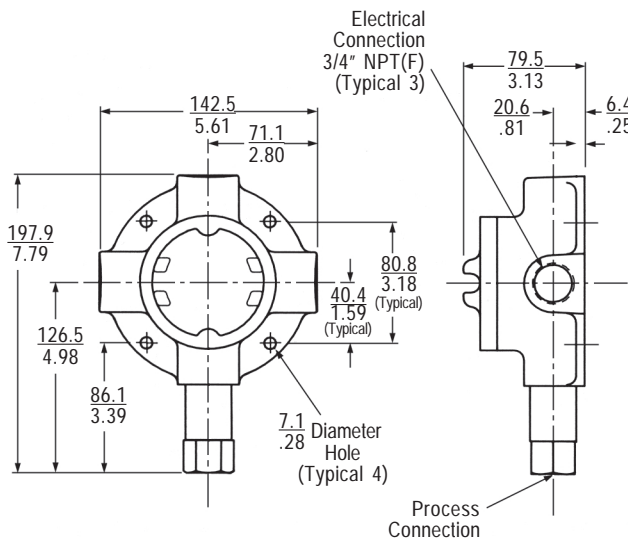

### Housing: S

Class I, Group C, D; Class II, Group E, F, G; Division 1 & 2

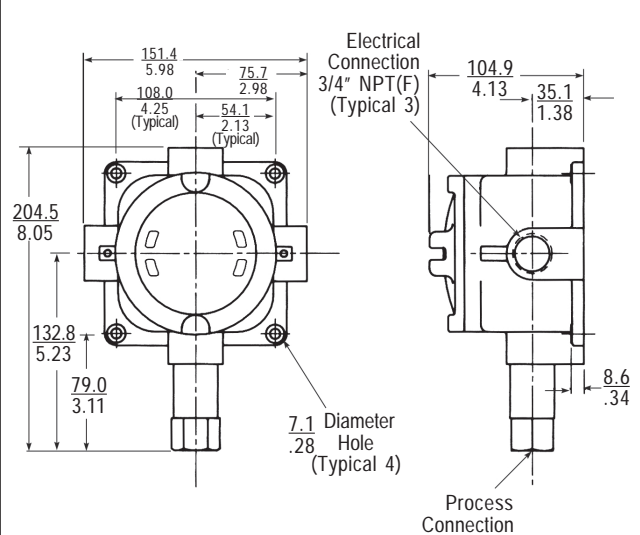

### Housing: SC


Class I, Group C, D; Class II, Group E, F, G; Division 1 & 2

# Pivot Seal Pressure Switches

## Dimensions


Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number. Dimensions in this catalog are expressed as millimeters over inches. (Linear = mm/in.).

### Conventional Explosion Proof – Hazardous Service

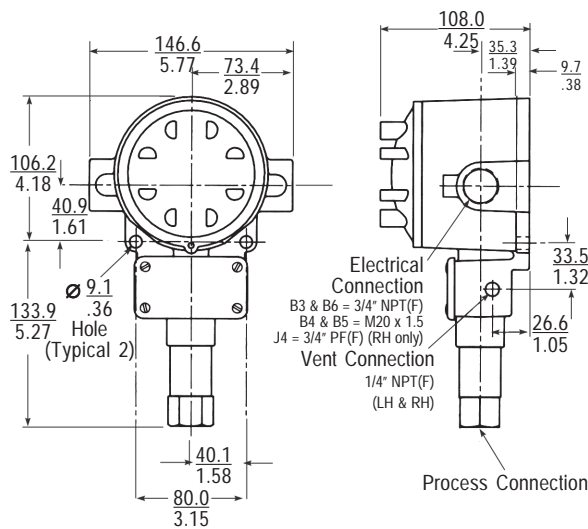

#### Housing: B3, B4, B5, B6, J4


Class I, Group B, C, D; Class II, Group E, F, G; Division 1 & 2

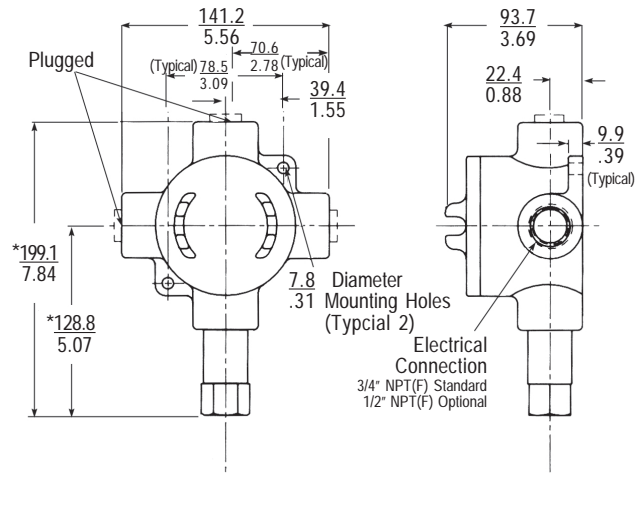

#### Housing: TA


Class I, Group A, B, C, D; Class II, Group E, F, G; Division 1 & 2

### Hermetically Sealed Explosion Proof – Hazardous Service

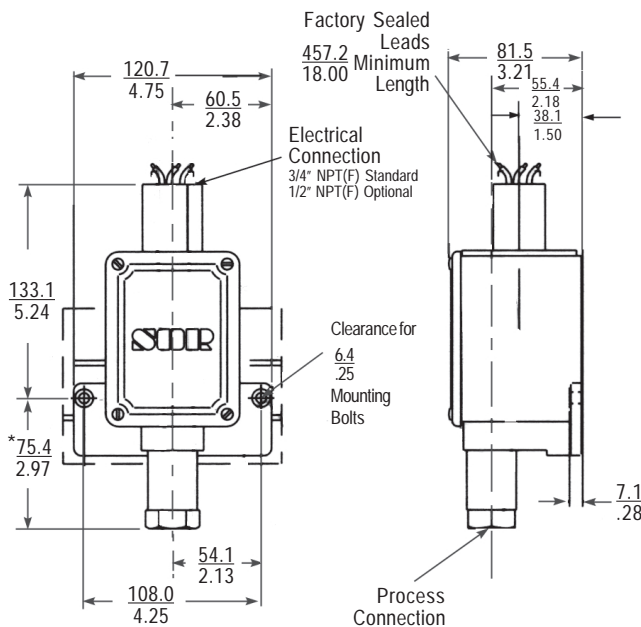

#### Housing: BA

Class I, Group A, B, C, D; Class II, Group E, F, G; Division 1 & 2

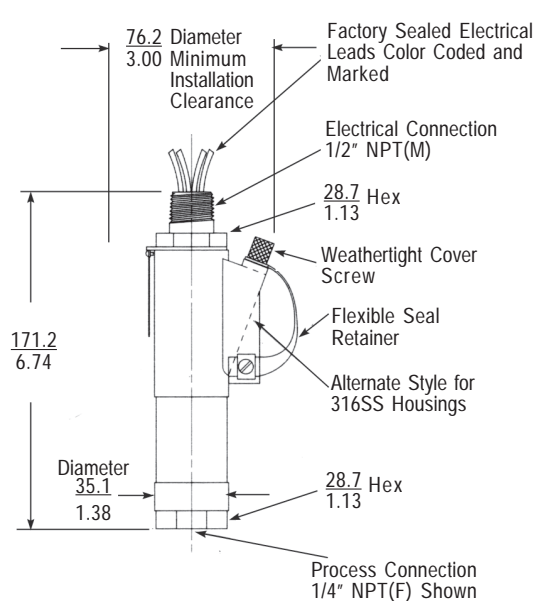

#### Housing: AG, AH, BG, BH, JH

Class I, Group A, B, C, D; Class II, Group E, F, G; Division 1 & 2


\*For 1/2" NPT(F) Add 13.2 mm (0.52 in.)

# Pivot Seal Pressure Switches


## Dimensions

Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number. Dimensions in this catalog are expressed as millimeters over inches. (Linear = mm/in.).

### General Purpose – Non-Hazardous Service

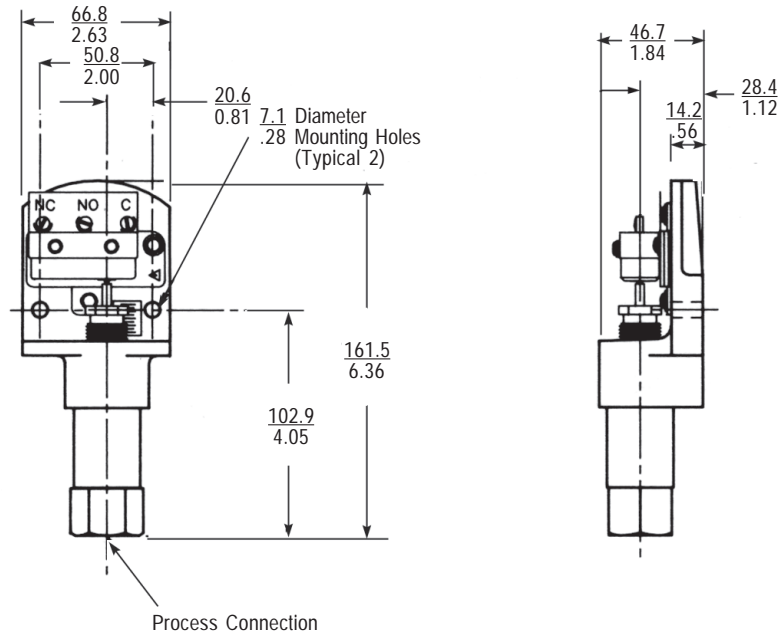

### Housing: H3 Open Bracket

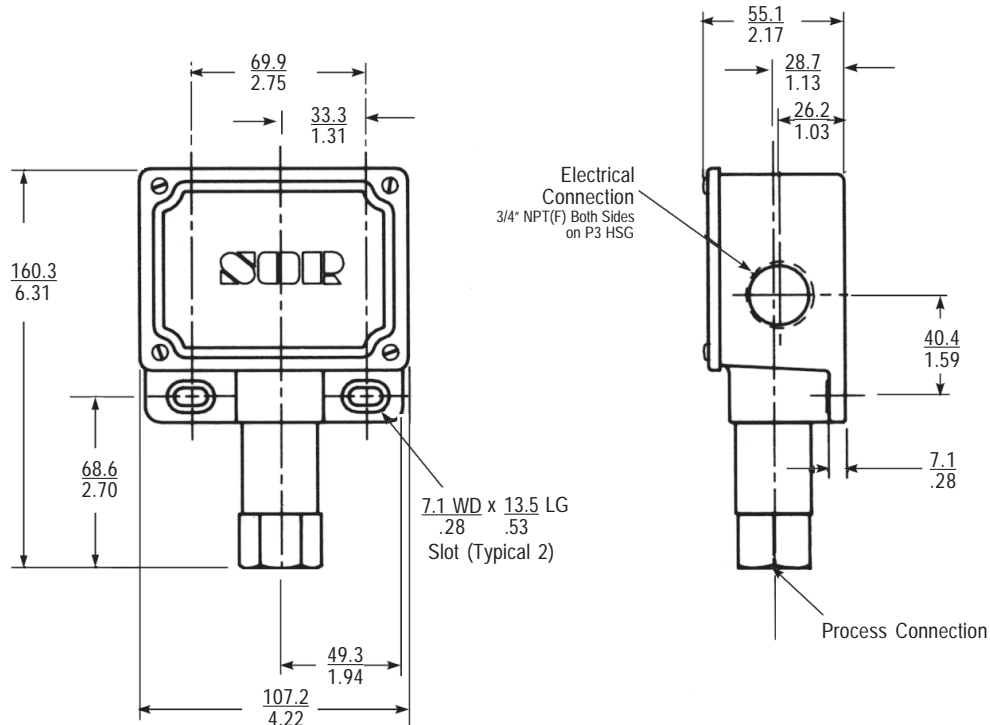


### Housing: PP, P3, NEMA 1

# Pivot Seal Pressure Switches

## Dimensions

Dimensions in this catalog are for reference only. They may be changed without notice. Contact the factory for certified drawings for a particular model number. Dimensions in this catalog are expressed as millimeters over inches. (Linear = mm/in.).


### Accessories

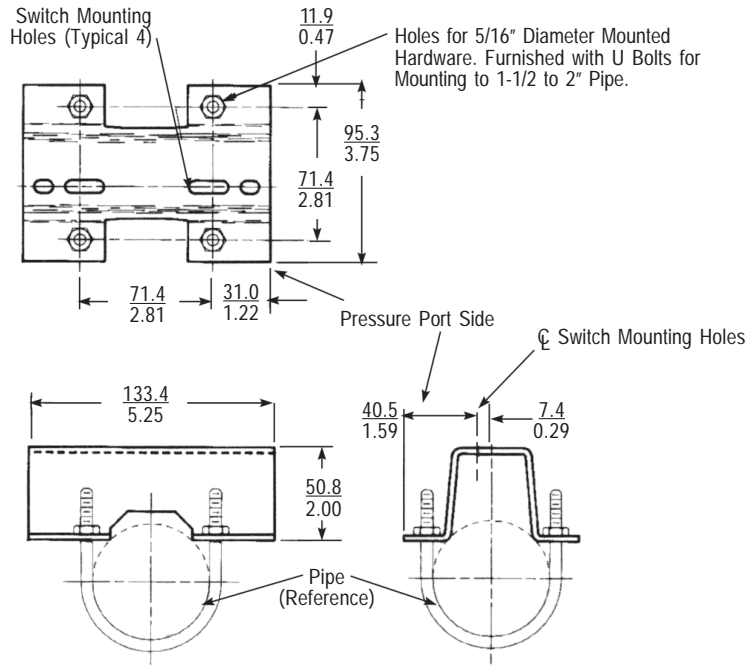

Perpendicular Mounting

Parallel Mounting

### Pipe Mounting Kit: PK

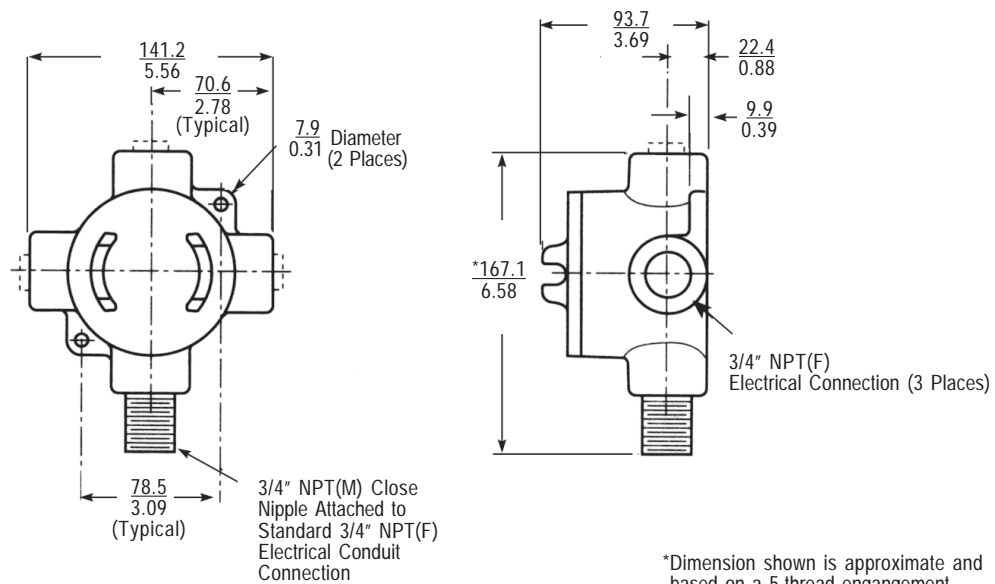

### Junction Box with Terminal Block: TB

